

Mounting Base for Hazardous Area Detectors

B401

B401DG

Instruction Sheet

R10137GB0



Schneider Electric Fire & Security Oy

Sokerilinnantie 11 C
FI-02600 Espoo, Finland
Tel: +358 10 446 511
Website: www.schneider-electric.com
Document number: R10137GB0
Published: 13.05.2019

© 2018 – Schneider Electric. All Rights Reserved. This information is only to be used as guidance. Subject to changes and errors.

Contents

1	Mounting Base for Hazardous Area Detectors B401 and B401DG	4
1.1	Mechanical assembly.....	4
1.2	Product Codes	4

1 Mounting Base for Hazardous Area Detectors B401 and B401DG

Bases B401 and B401DG are used for detectors designed to be used in hazardous areas of Zone 0.


Cables are brought into the base by breaking out the inset at the bottom edge of the base or through its bottom. A remote indicator or a buzzer can also be connected to the base.

The detector can be placed into the base in one position and fixed to the base simply by turning it.

Detaching detector from its base will cause a fault alarm in the fire detection system. Unauthorised removal of the detector without a special tool can be prevented by cutting the locking plastic strip end from the base.

For hazardous areas the bases B401 and B401DG are recommended to be used according to separate instructions.

1.1 Mechanical assembly

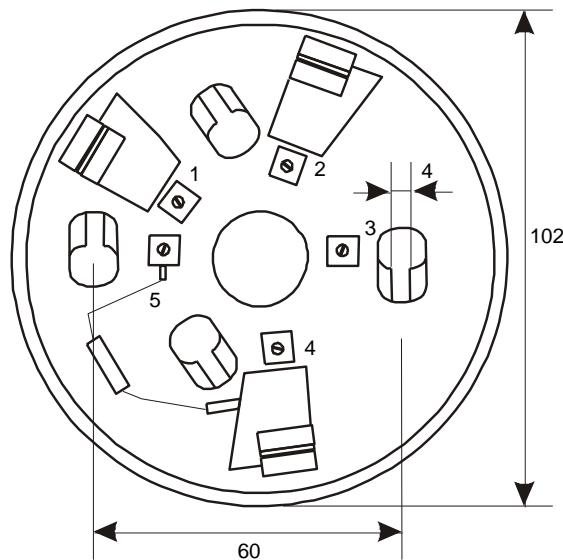

1.2 Product Codes

Description	Product Code
B401	FFS06715411
B401DG	FFS06715412